



**2014-2015 Wet Weather WQO Ratios
for S10 Los Angeles River at Wardlow Rd.**

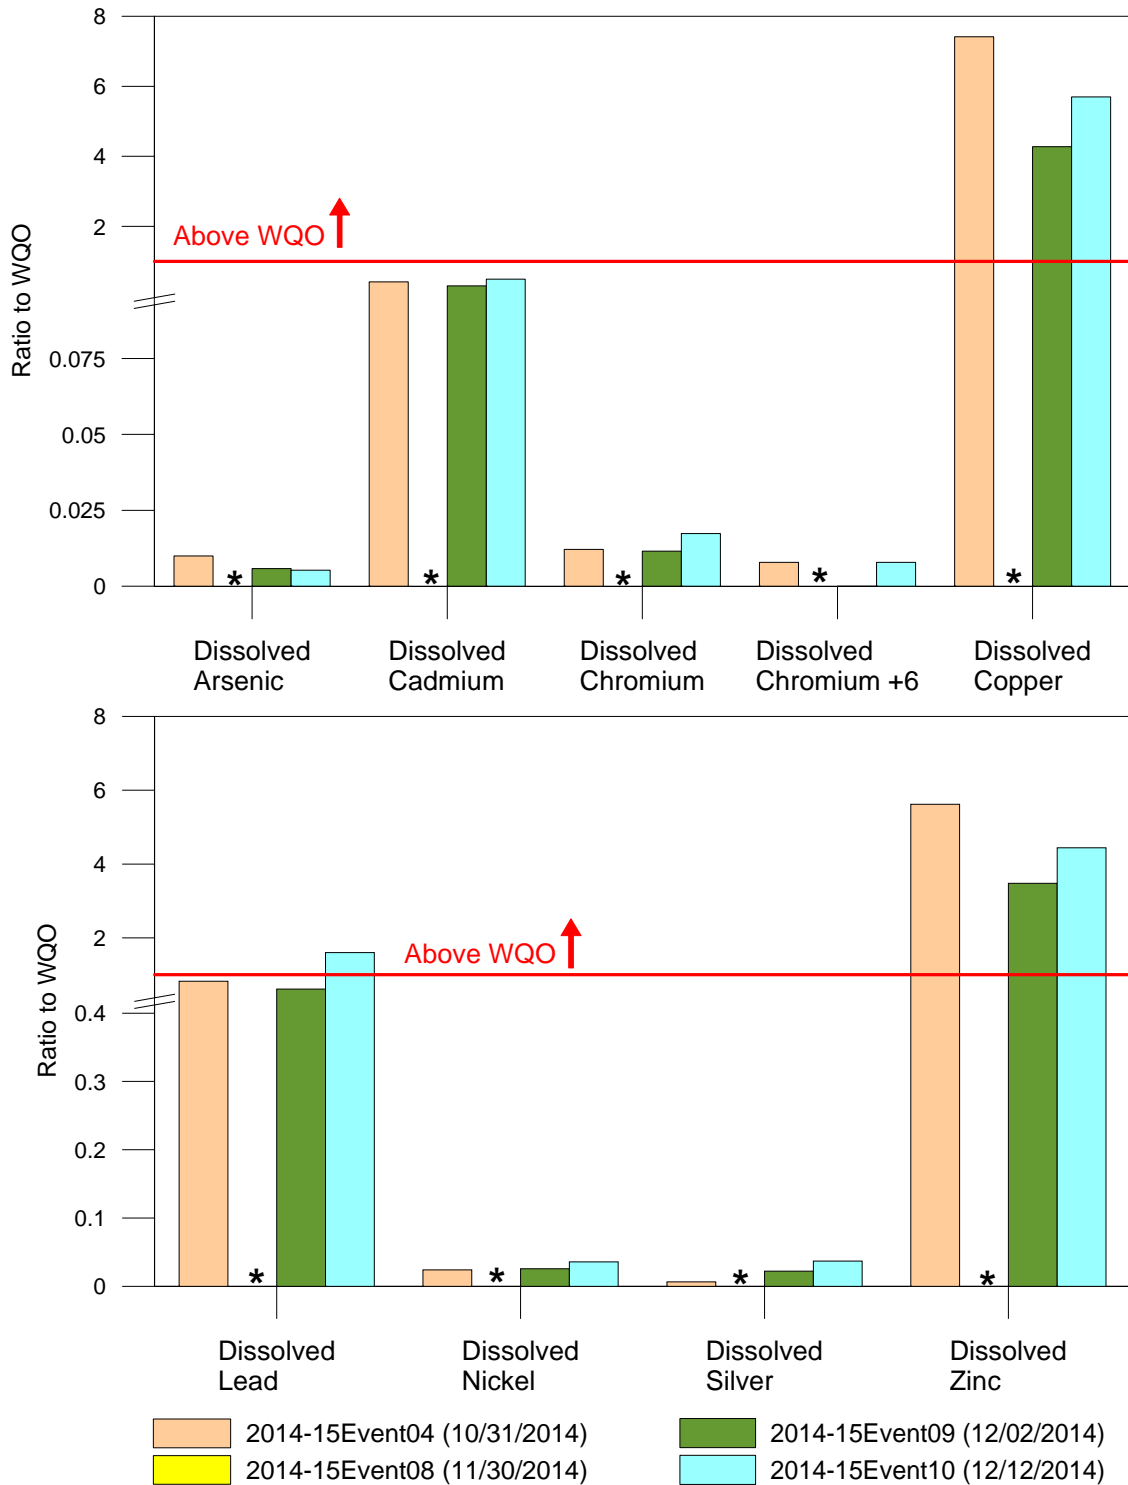

*Samples were not collected for dissolved metals during Event 08.


Figure 4-3.3 S10 Los Angeles River at Wardlow Rd. Wet Weather Ratio Plots

**2014-2015 Wet Weather WQO Ratios
for S10 Los Angeles River at Wardlow Rd.**

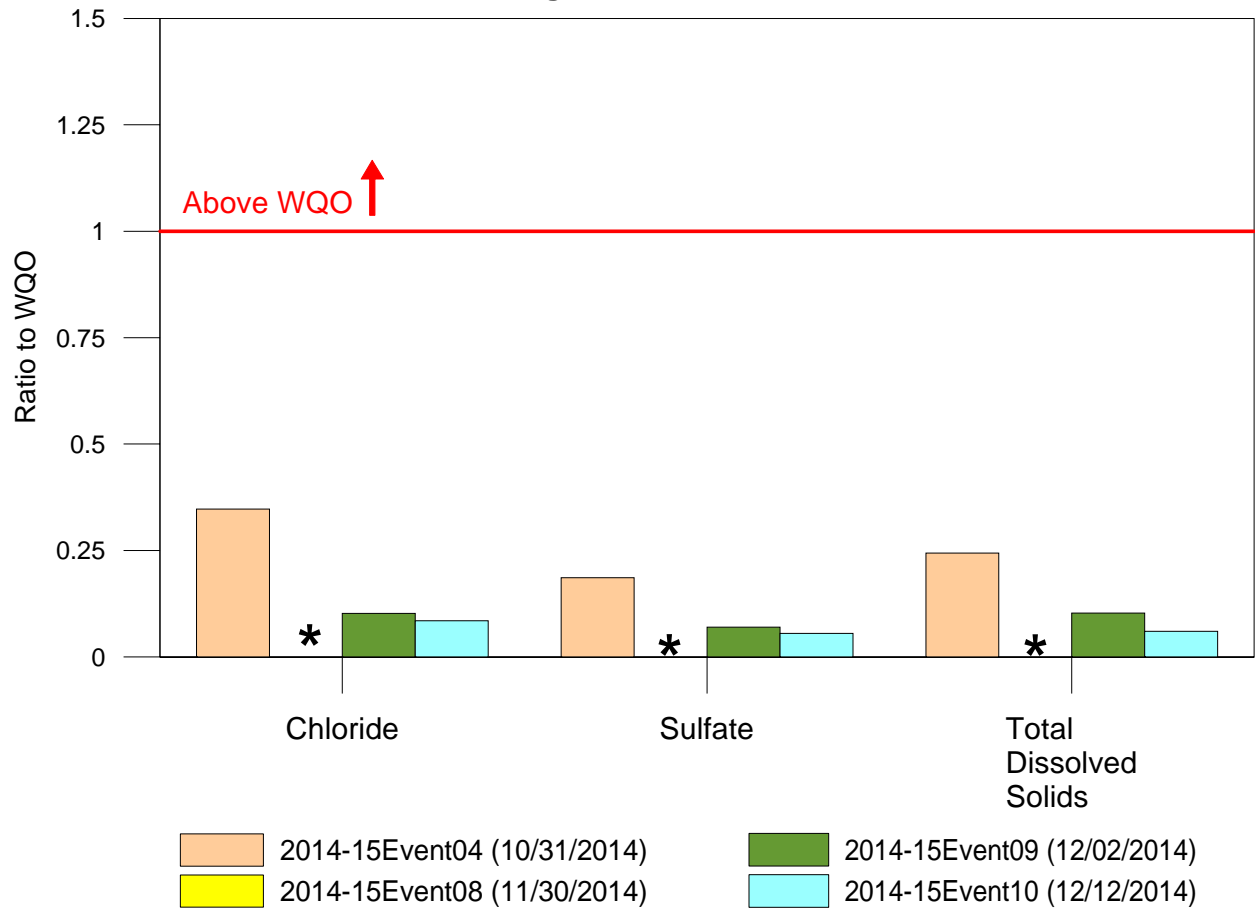

*Samples were not collected for chloride, sulfate, or total dissolved solids during Event 08.

Figure 4-3.3 S10 Los Angeles River at Wardlow Rd. Wet Weather Ratio Plots

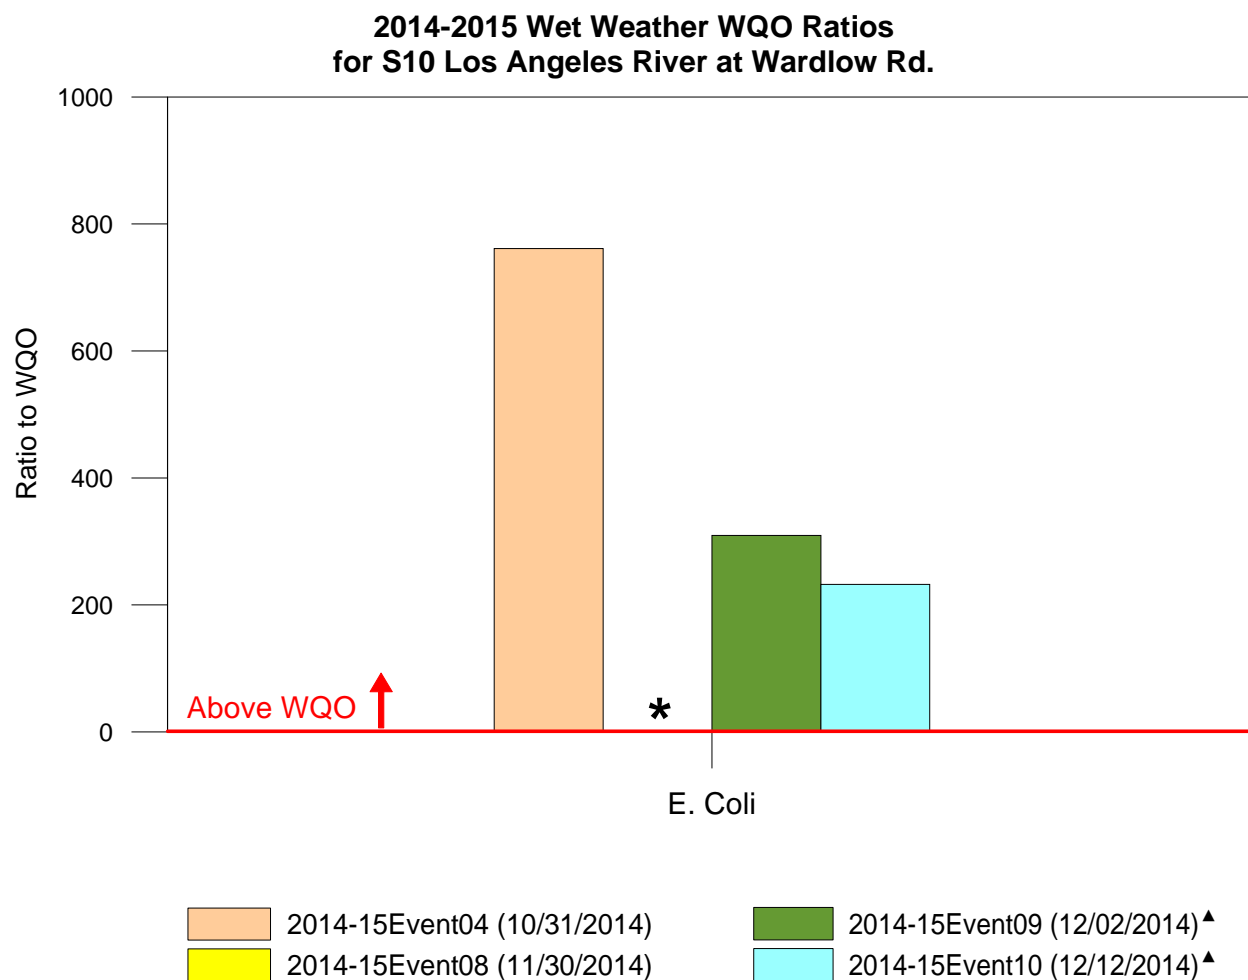


* Samples were not collected for fecal coliforms during Event 08.

▲ Not an exceedance of the E. coli water quality objective due to the High Flow Suspension of Recreational Uses (LARWQCB, 2003).

Figure 4-3.3 S10 Los Angeles River at Wardlow Rd. Wet Weather Ratio Plots

2014-2015 Wet Weather WQO Ratios for S10 Los Angeles River at Wardlow Rd.

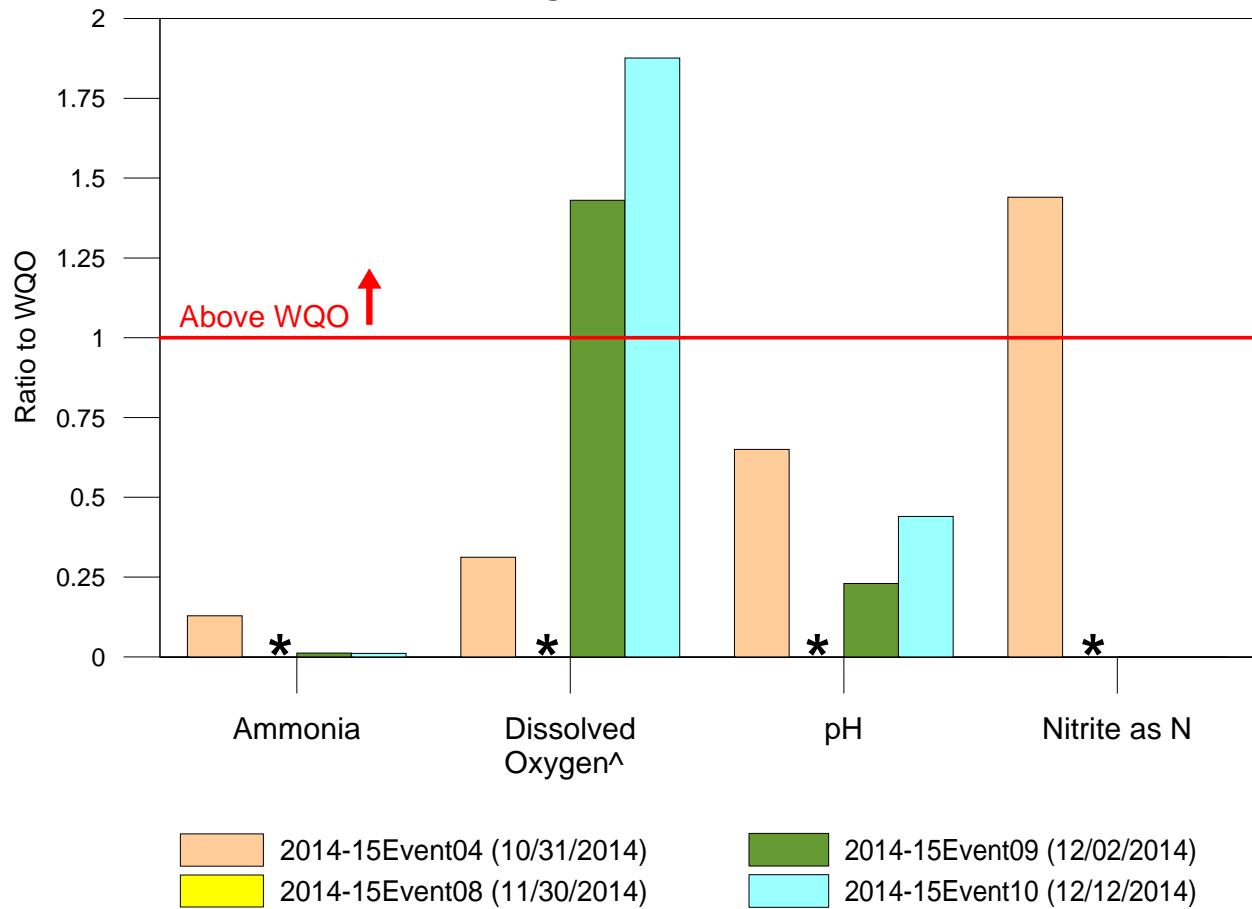

^Dissolved oxygen is an exceedance if ratio to WQO is below 1.

*Samples were not collected for ammonia, dissolved oxygen or pH during Event 08.

Figure 4-3.3 S10 Los Angeles River at Wardlow Rd. Wet Weather Ratio Plots